

ELEVATION

1. DESIGN CRITERIA


- 1.A. THE TANK AND SUPPORT STRUCTURE SHALL BE DESIGNED, FABRICATED, AND ERECTED IN ACCORDANCE WITH AWWA D100-11 AND THE PROJECT SPECIFICATIONS.
- 1.B. LOADING CRITERIA:
  - 1.B.A. DESIGN WIND VELOCITY - \_\_\_\_\_ MPH
  - 1.B.B. DESIGN SNOW LOAD - \_\_\_\_\_ PSF
  - 1.B.C. MCE SPECTRAL RESPONSE ACCELERATION - 0.2 - SEC PERIOD ( $S_s$ ) - \_\_\_\_\_
  - 1.B.D. MCE SPECTRAL RESPONSE ACCELERATION - 1.0 - SEC PERIOD ( $S_1$ ) - \_\_\_\_\_


2. MATERIALS

- 2.A. STEEL PLATE: ASTM A283 OR ASTM A36
- 2.B. STRUCTURAL SHAPES: ASTM A36 OR ASTM A992
- 2.C. LADDER RUNGS: ASTM A706

3. GENERAL

- 3.A. ALL ACCESSORIES SHOWN ON THE ELEVATION DRAWING ARE ROTATED FOR CLARITY.
- 3.B. THE NUMBER OF PERIMETER COLUMNS SHALL BE PER MANUFACTURER'S STANDARD DESIGN.
- 3.C. ALL LADDERS, LADDER SAFETY DEVICES, PLATFORMS, HANDRAILS, ETC. SHALL CONFORM TO CURRENT OSHA REGULATIONS.
- 3.D. TANK CONTRACTOR SHALL GROUT BENEATH COLUMN AND RISER BASE PLATES UPON COMPLETION OF ERECTION.
- 3.E. SURFACE PREPARATION AND COATING REQUIREMENTS SHALL BE IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.
- 3.F. THE TANK SHALL BE DISINFECTED IN ACCORDANCE WITH AWWA C652-02.

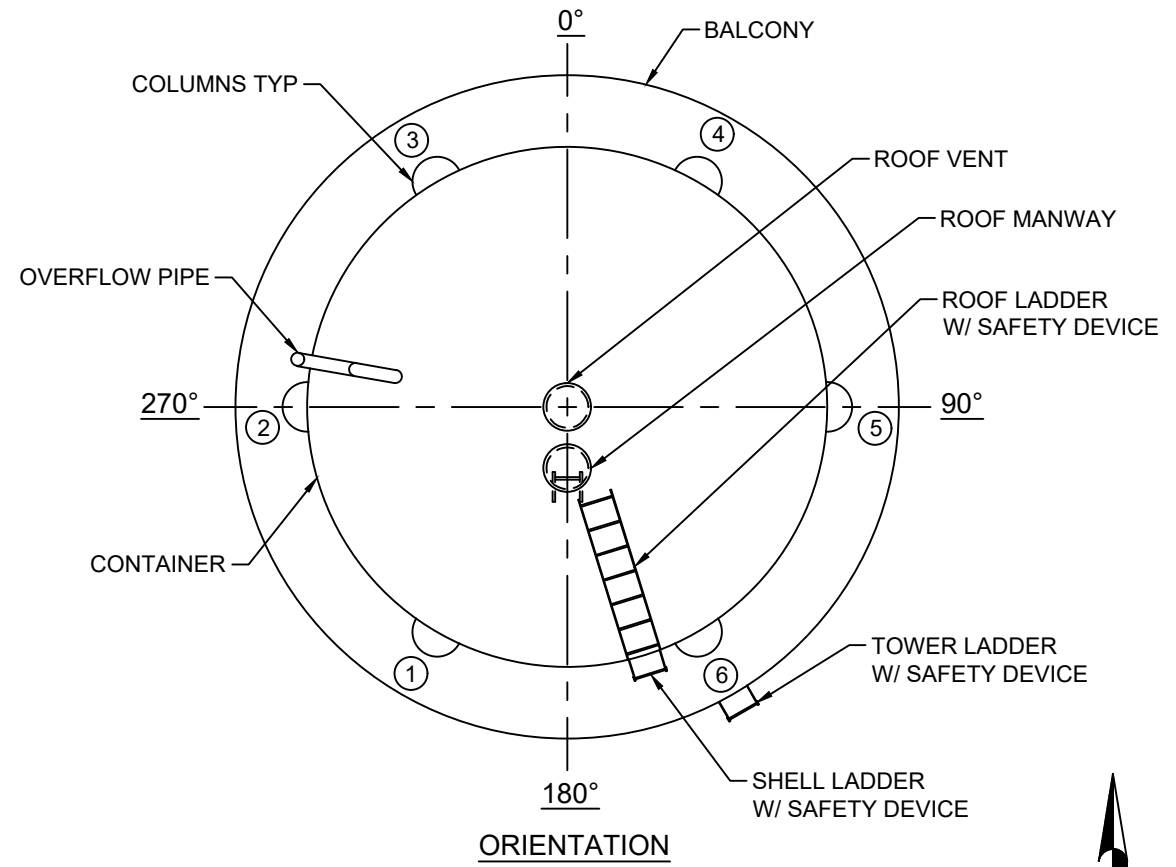

|  |   |
|--|---|
| 400,000 GALLON ELEVATED TORO-ELLIPTICAL TANK   | GENERAL ELEVATION                                   |
| <br>Avon, Indiana - Sebree, Kentucky  | ENGINEER: _____<br>CHECKED BY: _____<br>DATE: _____ |
| JOB No. _____  | SHEET _____   |
| Revision Description<br>Rev. By Rev. Date<br>Copyright © 2017 by Phoenix Fabricators & Erectors, LLC. All rights reserved. |   |