

ELEVATION

1. DESIGN CRITERIA


- 1.A. THE TANK AND SUPPORT STRUCTURE SHALL BE DESIGNED, FABRICATED, AND ERECTED IN ACCORDANCE WITH AWWA D100-11 AND THE PROJECT SPECIFICATIONS.
- 1.B. LOADING CRITERIA:
 - 1.B.A. DESIGN WIND VELOCITY - _____ MPH
 - 1.B.B. DESIGN SNOW LOAD - _____ PSF
 - 1.B.C. MCE SPECTRAL RESPONSE ACCELERATION - 0.2 - SEC PERIOD (S_s) - _____
 - 1.B.D. MCE SPECTRAL RESPONSE ACCELERATION - 1.0 - SEC PERIOD (S_1) - _____

2. MATERIALS

- 2.A. STEEL PLATE: ASTM A283 OR ASTM A36
- 2.B. STRUCTURAL SHAPES: ASTM A36 OR ASTM A992
- 2.C. LADDER RUNGS: ASTM A706

3. GENERAL

- 3.A. ALL ACCESSORIES SHOWN ON THE ELEVATION DRAWING ARE ROTATED FOR CLARITY.
- 3.B. THE NUMBER OF PERIMETER COLUMNS SHALL BE PER MANUFACTURER'S STANDARD DESIGN.
- 3.C. ALL LADDERS, LADDER SAFETY DEVICES, PLATFORMS, HANDRAILS, ETC. SHALL CONFORM TO CURRENT OSHA REGULATIONS.
- 3.D. TANK CONTRACTOR SHALL GROUT BENEATH COLUMN AND RISER BASE PLATES UPON COMPLETION OF ERECTION.
- 3.E. SURFACE PREPARATION AND COATING REQUIREMENTS SHALL BE IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.
- 3.F. THE TANK SHALL BE DISINFECTED IN ACCORDANCE WITH AWWA C652-02.

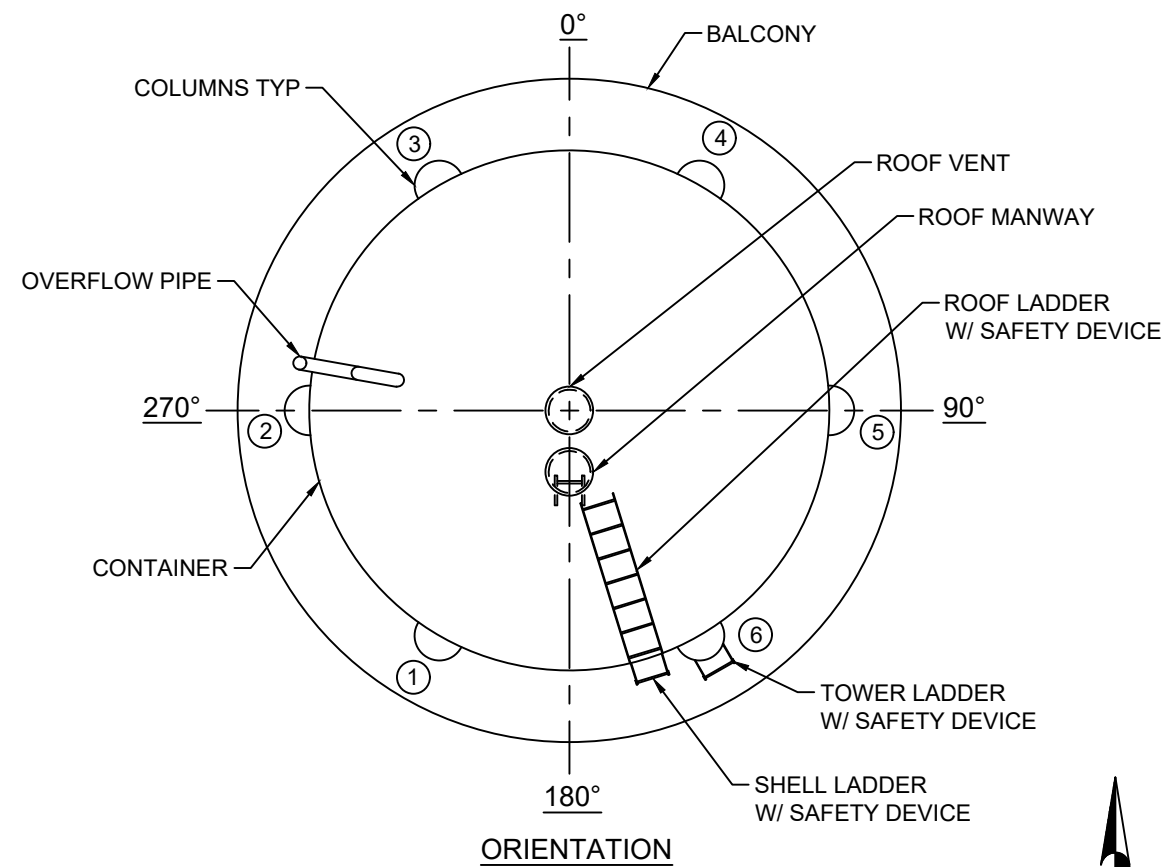

ORIENTATION

500,000 GALLON ELEVATED TORO-ELLIPTICAL TANK

GENERAL ELEVATION

Revision Description	Revision	Rev. Date	Checked By:	Date:
	1			
	2			
	3			
	4			
	5			
	6			
	7			
	8			
	9			
	10			
Avon, Indiana - Sebree, Kentucky				
Engineer: _____ Drawn By: _____ Checked By: _____ Date: _____				
JOB. No. _____				
SHEET _____				

Copyright © 2017 by Phoenix Fabricators & Erectors, LLC. All rights reserved.